
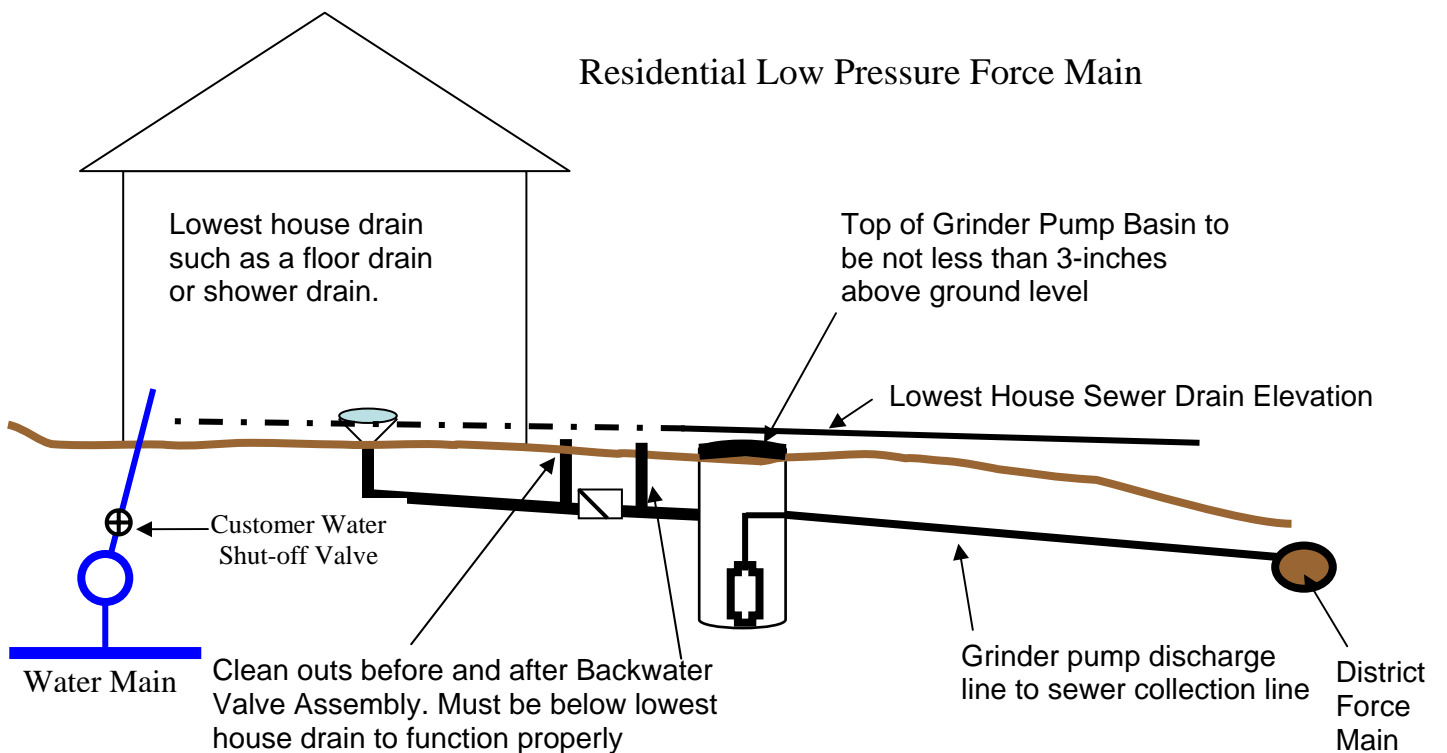


ECCFWSD Required Sewer Plumbing Installation

NOTE: Clean-out before and after Backwater Valve must have Pop-Off Relief assemblies installed instead of Threaded Cap Lids.

NOTE: Customer Water Shut-Off Valve to be within 3-feet of water meter on new and renovation projects.

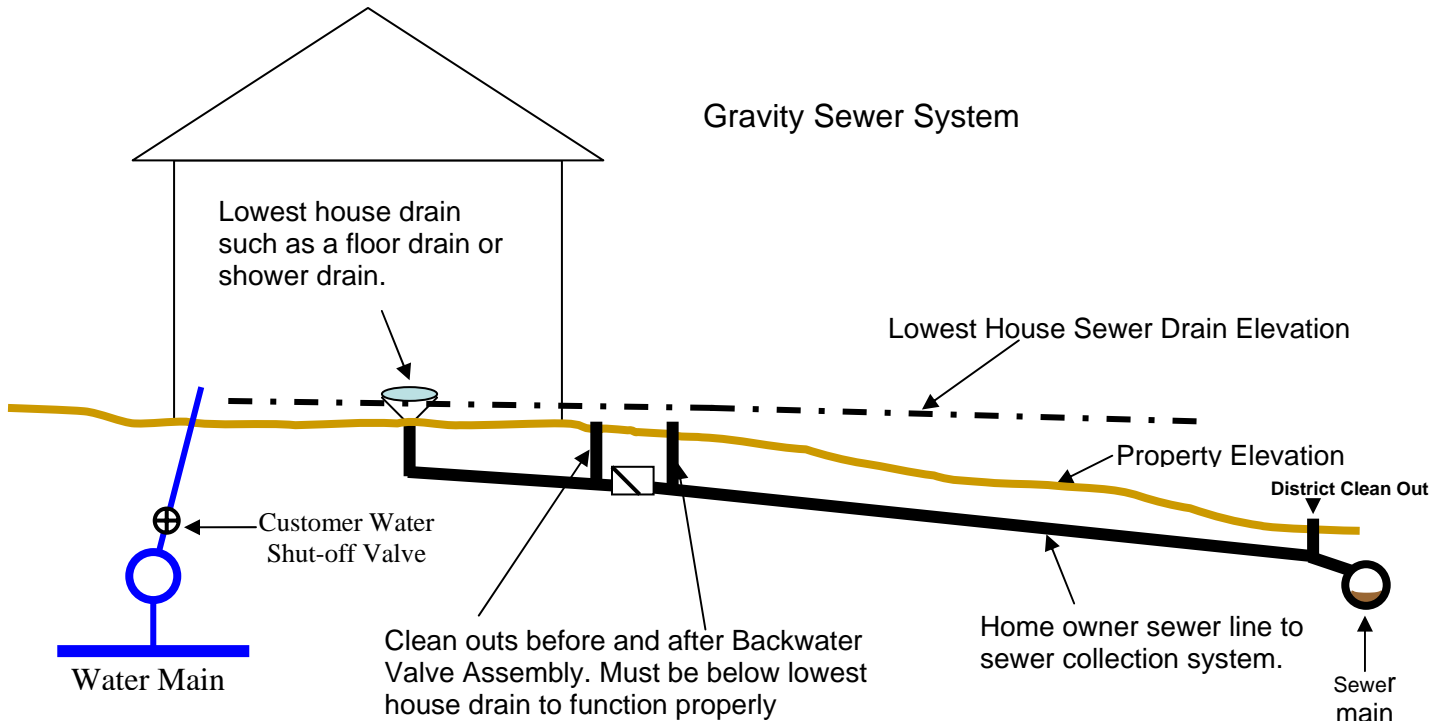

User Signature: _____